

8

7

6

5



4

3

2

1

NOT SHOWN:
CONSOLE IN CAB

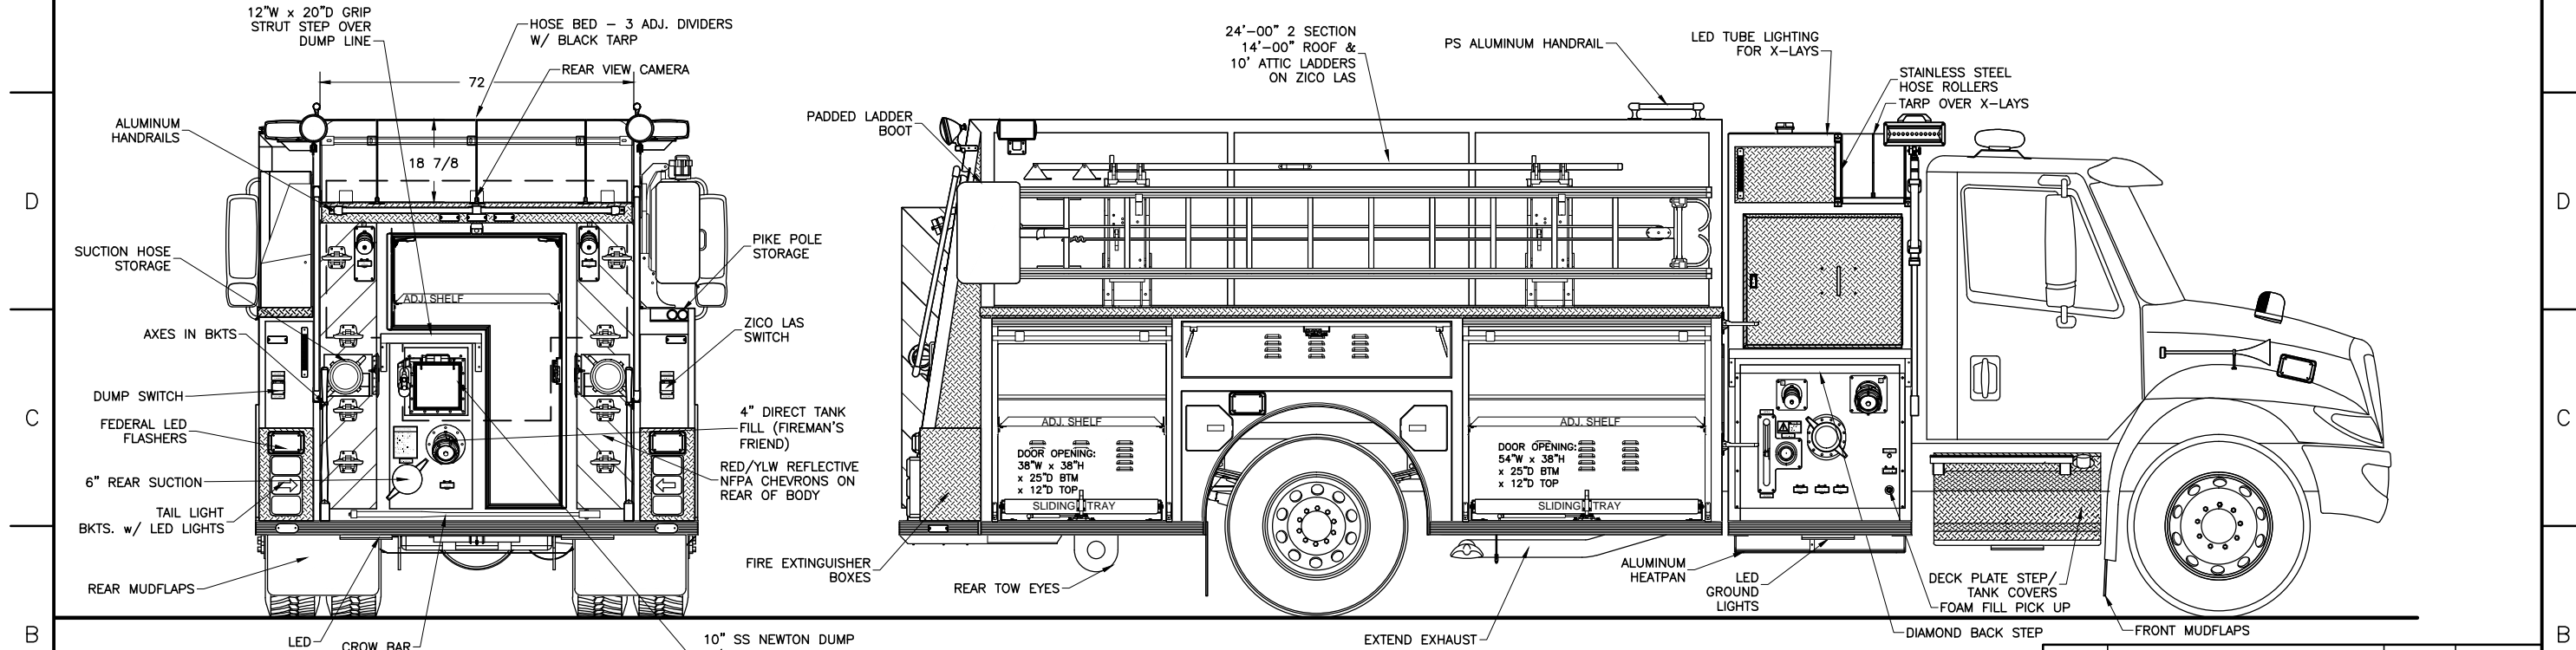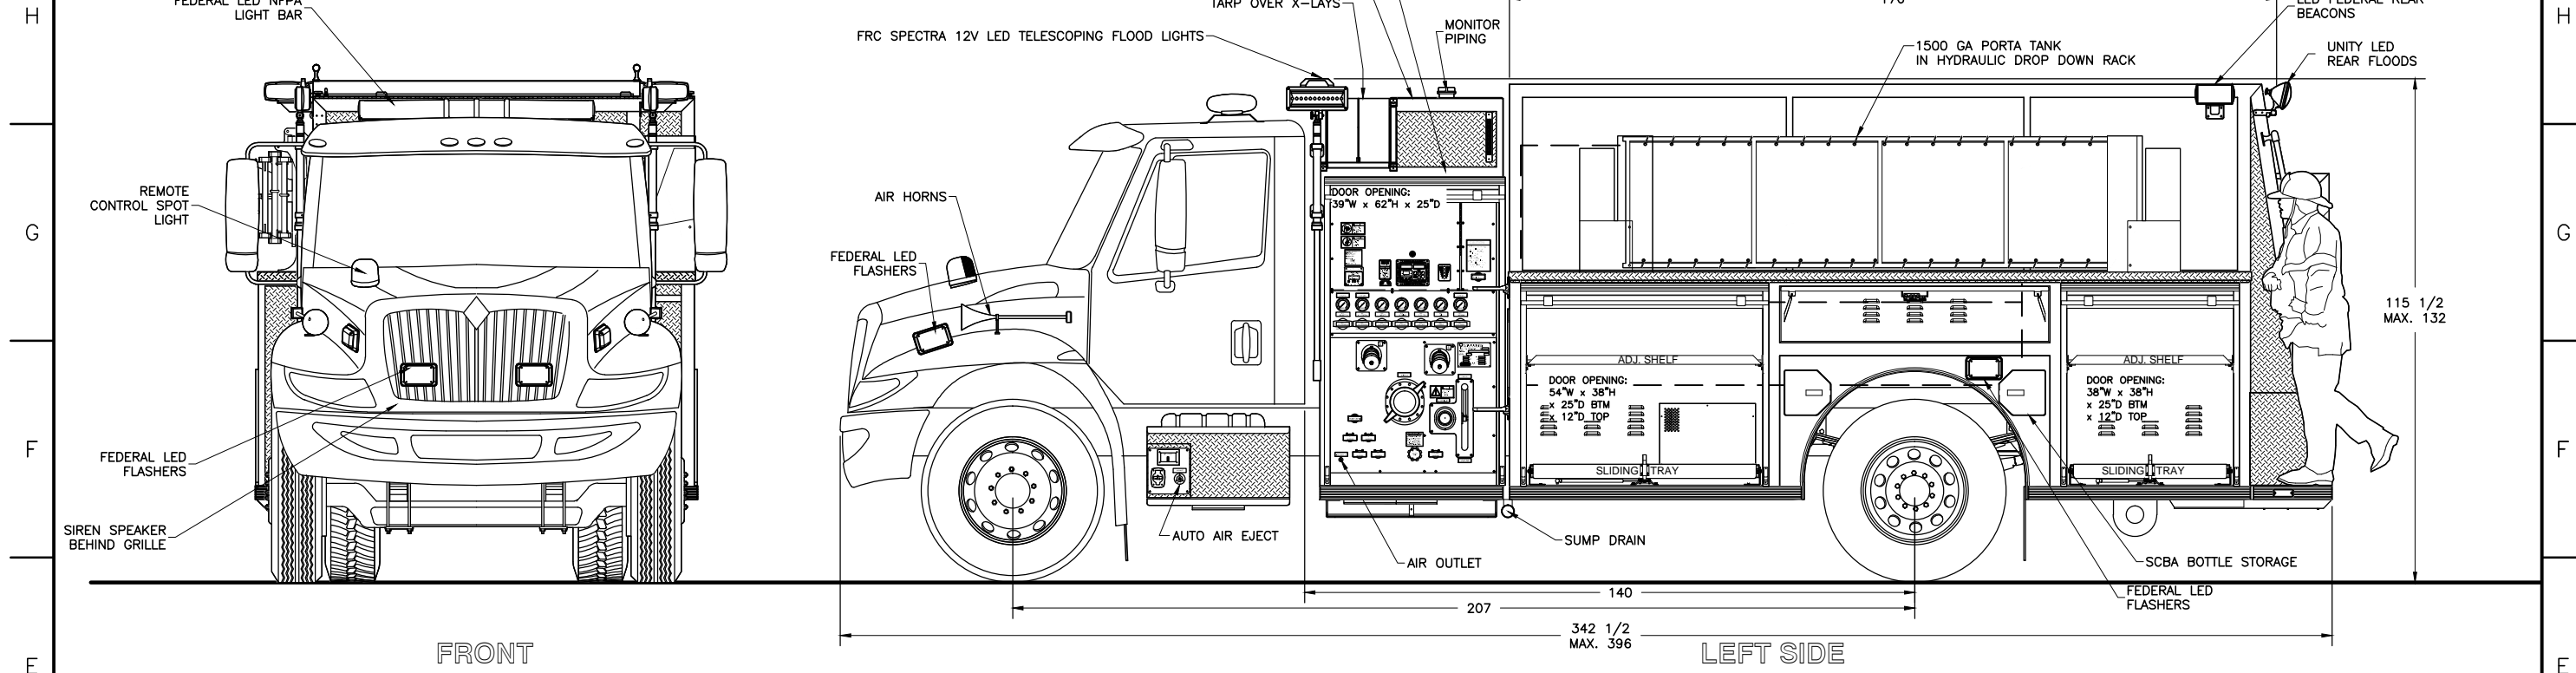

REV	DESCRIPTION	APVD BY	DATE
2	UPD'D P.H. AND FENDER DOORS		
1	UPD'D FROM FT-10572		06/01/2015

<p>CHASSIS: INTERNATIONAL 4400 PUMP: HALE QFLO 1050 IGPM TANK: 1000 Imp. Gal, POLYPROPYLENE 1 - 20 Imp. Gal. FOAM CELL FOAM: HYPRO FOAMPRO 2001 SINGLE</p>	<p>SUCTION: 1 - 6" REAR (5" PIPE, ELEC MIV) 1L, 1R - 6" (ELEC MIV) 1L, 1R - 2 1/2" 1 - 4" TANK TO PUMP</p>	<p>DISCHARGES: 1 - 4" RIGHT 2 - 1 1/2" CROSSLAYS (FOAM) 1 - 3" MONITOR 2 - 2 1/2" LEFT 1 - 2 1/2" RIGHT (FOAM) 2 - 2 1/2" REAR (FOAM RS ONLY) 1 - 3" TANK FILL</p>
--	---	--

<p>LAKEVILLE FIRE DEPARTMENT</p>		<p>TITLE GENERAL ARRANGEMENT</p>	
<p>JOB No. 18240</p>			
<p>DRAWN BY J. O'LEARY</p>			
<p>DATE 6-1-15</p>			

-ALL ALUMINUM CONSTRUCTION - ALL DIMENSIONS ARE IN INCHES & APPROXIMATE

8

7

6

5

4

3

2

1

DRAWING NO.	FT-10679	REV	1
-------------	----------	-----	---