NOT SHOWN:

KUSSMAUL BATT. CONDITIONOR
POWER SHIFT PTO w/ PUMP & ROLL
INTERNATIONAL DIAMOND LOGIC ELEC. SYSTEM
FEDERAL SIREN
TURTLE TILE COMPT. MATTING

KROWN UNDERCOATING
REFLECTIVE STRIPING

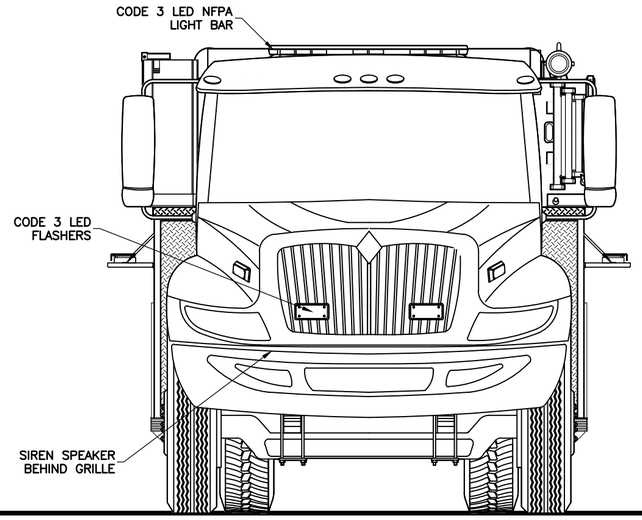

FRONT

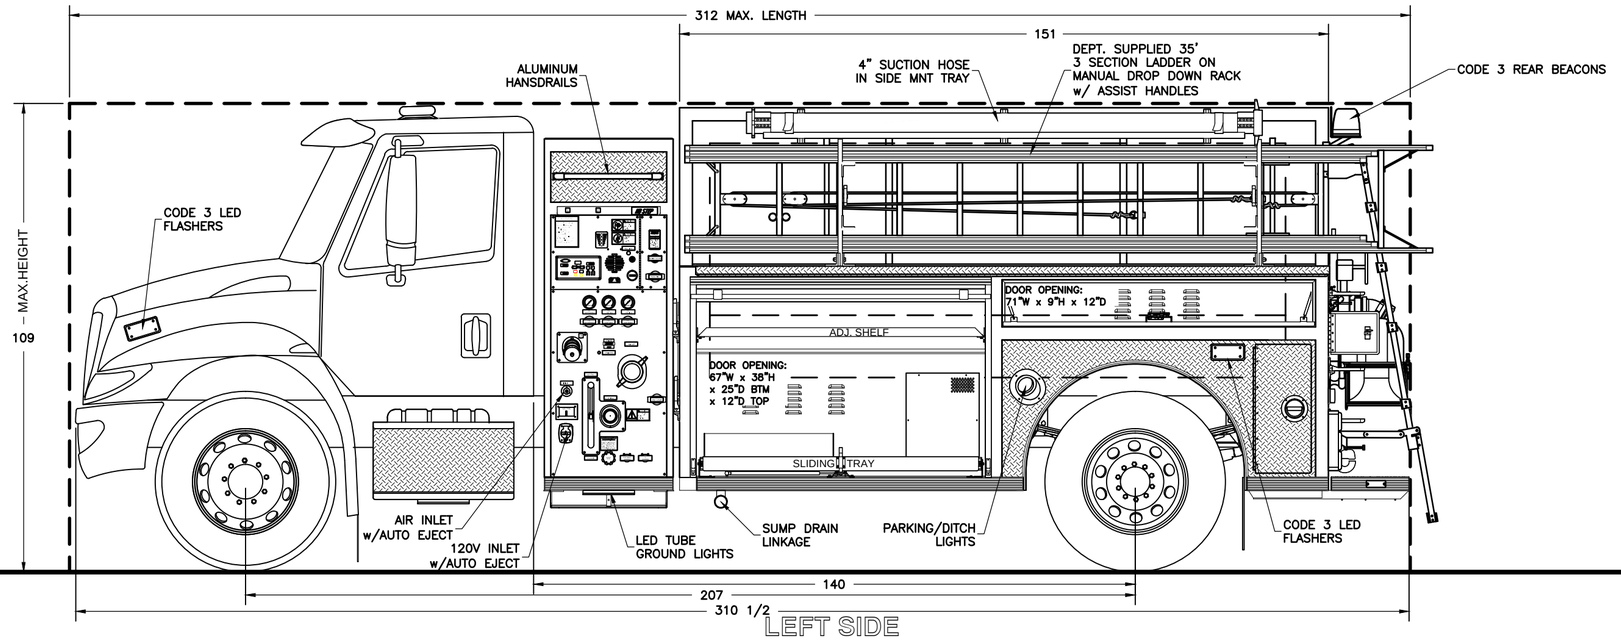

LEFT SIDE

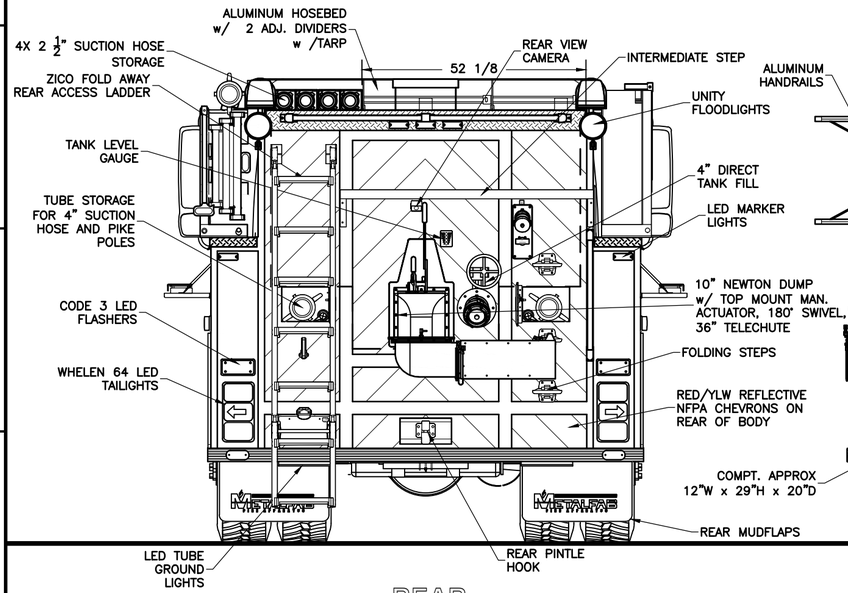

REAR

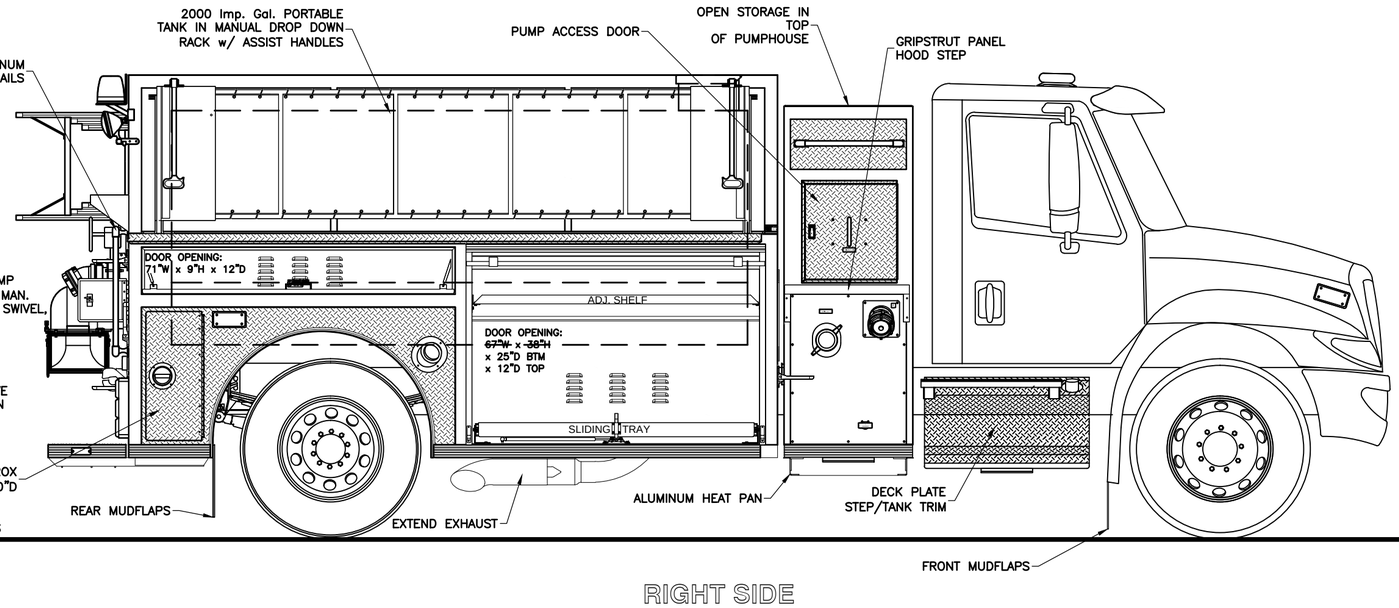

RIGHT SIDE

CHASSIS: INTERNATIONAL 4400 2 DOOR
PUMP: HALE AP 420 IGPM PTO DRIVE
TANK: 1500 Imp. Gal. POLYPROPYLENE

FOAM: N/A

SUCTION: 1 – 4" RIGHT–5"HEADER
1 – 4" LEFT– 5"HEADER
1 – 3" TANK TO PUMP (4" PIPING)
1 – 2 1/2" LEFT

DISCHARGES: 1 – 4" RIGHT
1 – 2 1/2" LEFT
1 – 2 1/2" REAR
1 – 2" TANK FILL

REV	DESCRIPTION	APVD BY	DATE
1	SHOP ORDER REVIEW		
0	FIRST ISSUE	----	----

REVISIONS

PORT MAITLAND FIRE DEPARTMENT

JOB No. 18699
DRAWN BY T CULLINS
DATE 05-06-15

METALFAB LTD.
847 CENTRAL ST. CENTREVILLE
NB. CANADA E7K 2E8

TITLE GENERAL ARRANGEMENT

METALFAB FIRE APPARATUS

DRAWING NO. FT-10731
REV 1

–ALL ALUMINUM CONSTRUCTION – ALL DIMENSIONS ARE IN INCHES & APPROXIMATE